

Shutter Ref/No: Fire Shutter

Please Note: Head Plate, Angles & Guide Sizes, Are Available On Request, As They Change Depending On The Shutter Width & Height.

HAG




THE DOOR SPECIALISTS

HAG, 1 OAK LANE, FISHPONDS,
BRISTOL BS5 7UY.
TEL 0117 9654 888
EMAIL INFO@HAG.CO.UK

Product Ref: FT01 1 Hour Fire Shutter
Operation: Single Phase Tube Motor
Operator: Keyswitch, FCP03 Audio Visual Warning Panel (1 Side) & Battery Back Up (Shutter To Close Upon Fire Alarm)
Fixing: Face Fixed
Finish: Galvanised Or PPC RAL (TBC)
Canopy & Fascia: Yes
Power Requirements: 13 Amp Fused Spur, Within 600mm Of Opening
Certification: BS EN 15269-10:2011, BS EN 1634-1:2014, & EN 13501-2 2016
Notes:
Must Be Fitted To Steel Work Or Non-Thermalized Masonry. If Installing HAG Will Wire Panel & Keyswitch (If Steel Containment Is Required, This Is To Be Supplied & Installed By The Main Contractor Not HAG). Client To Provide 13 AMP Fused Spur (Dedicated Supply & Alarm Engineer To Wire "0" Volt Contact To Our Panel On Installation (Return Visits, To Commision Will Be At An Extra Cost) Full Width Of The Shutter Is Required For Maintenance.

Scale: NTS
Sign.....
Print.....
Date.....

SECURITY DOORS
FIRE DOORS
AUTOMATIC DOORS
ENVIRONMENTAL DOORS
WWW.HAG.CO.UK

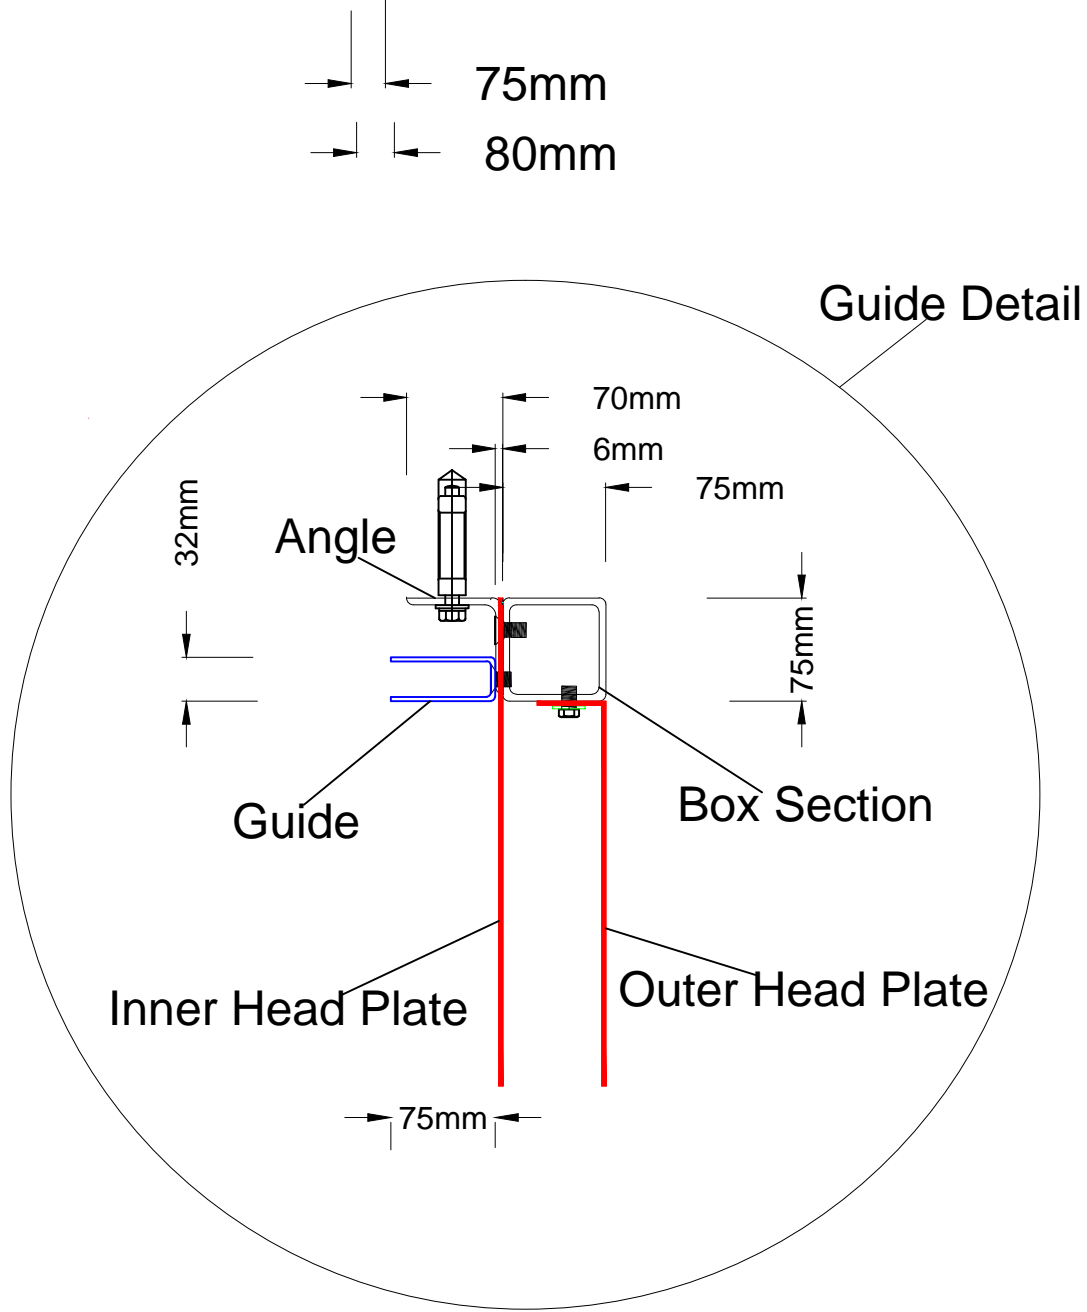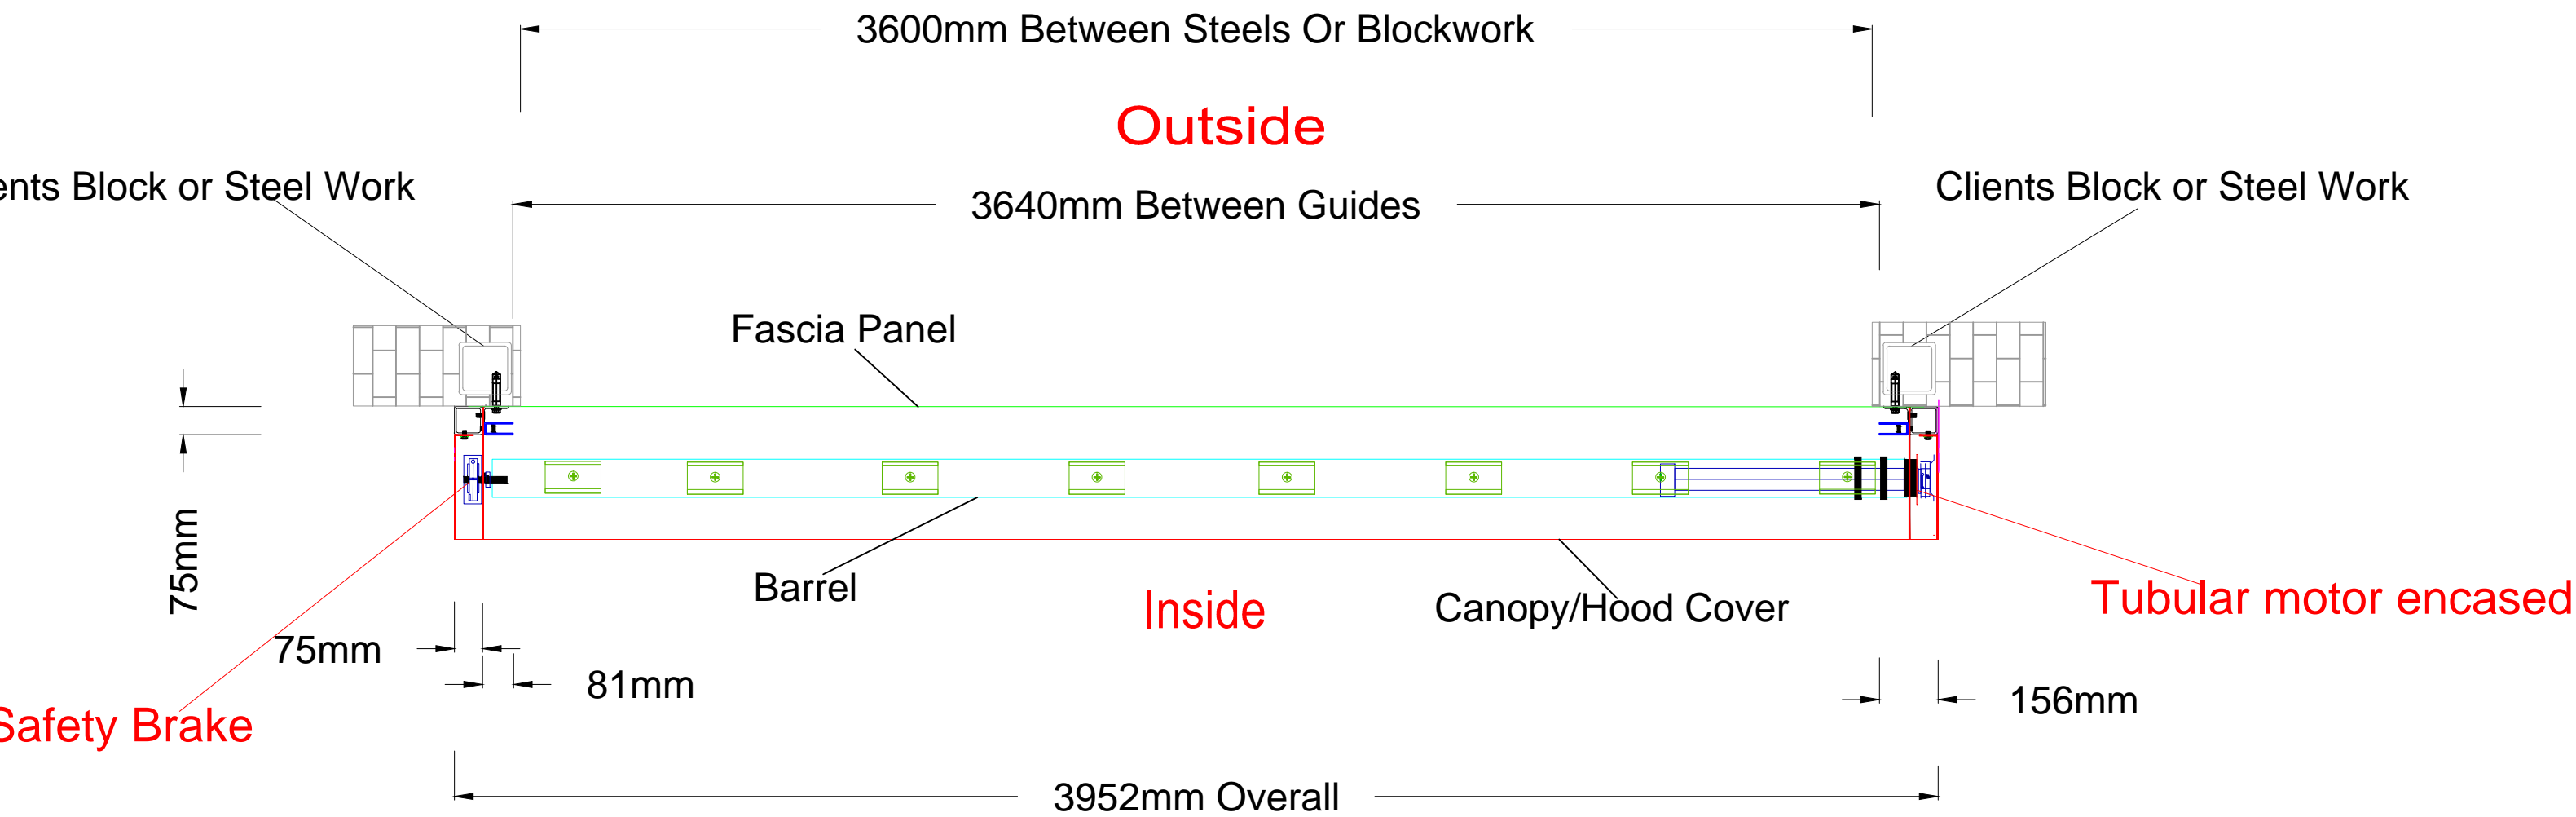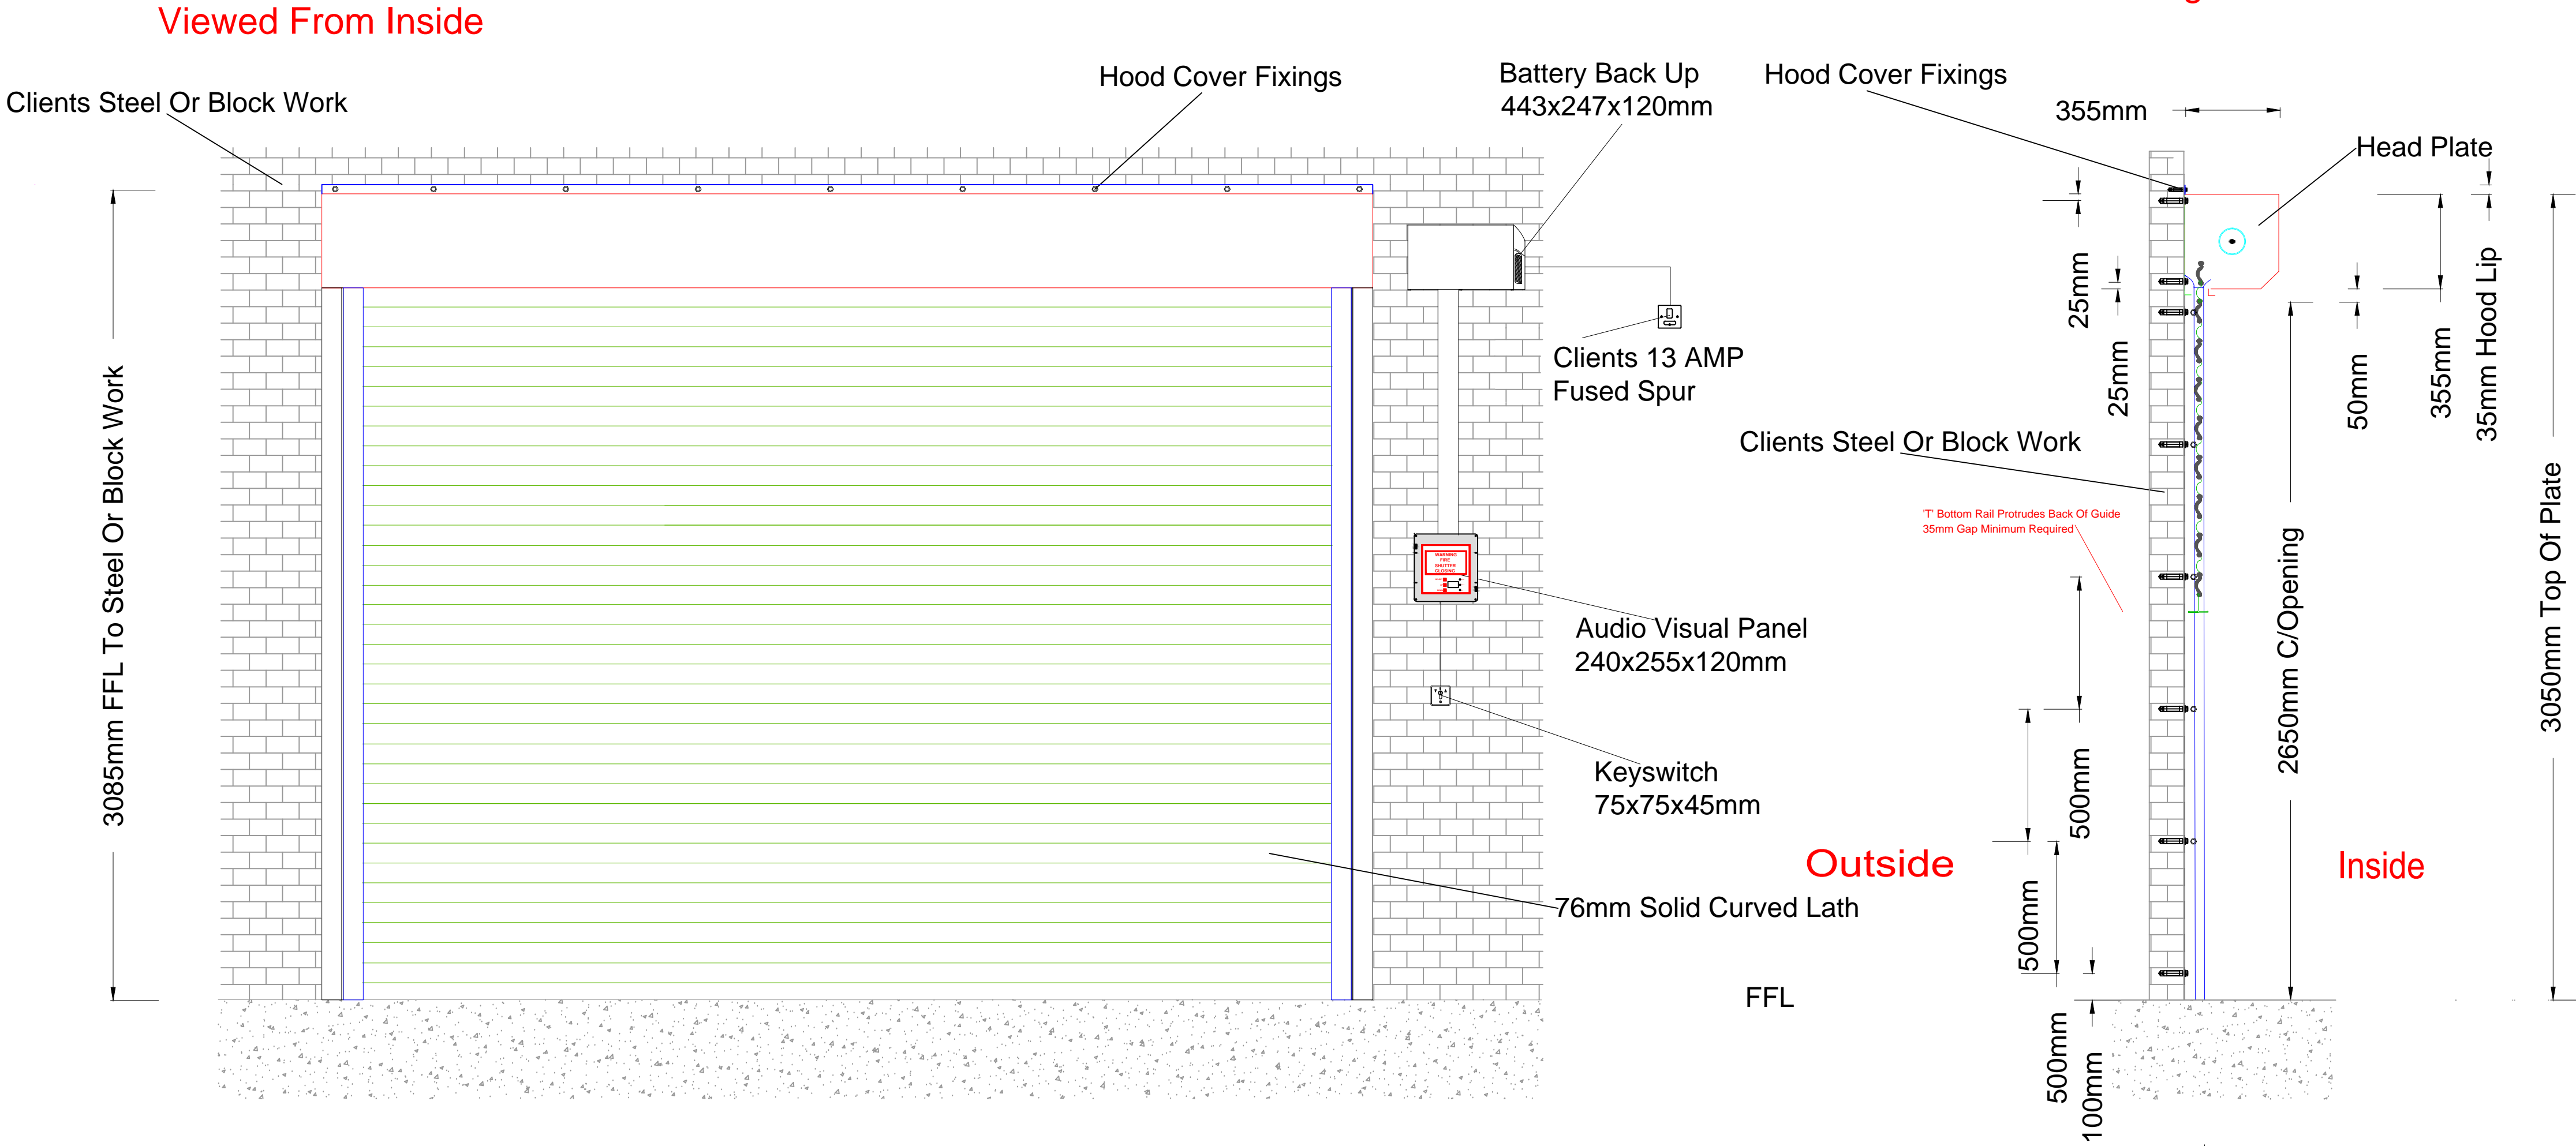

Disclamier

HAG operates a policy of continuous improvements, product specification may change, and it is advisable to consult with HAG technical advisors Before specifying or ordering